


NOTES:

1. DROP CONNECTIONS SHALL BE REQUIRED WHENEVER AN INFLUENT SEWER IS LOCATED TWO (2) FEET OR MORE ABOVE THE MAIN INVERT CHANNEL.
2. A FLOW CHANNEL SHALL BE CONSTRUCTED INSIDE MANHOLE TO DIRECT INFLUENT INTO FLOW STREAM.
3. PIPING IN DROP SHALL BE ALL PVC OR ALL, VCP OR ALL DUCTILE IRON AS REQUIRED BY ZONING OR MDWASD.

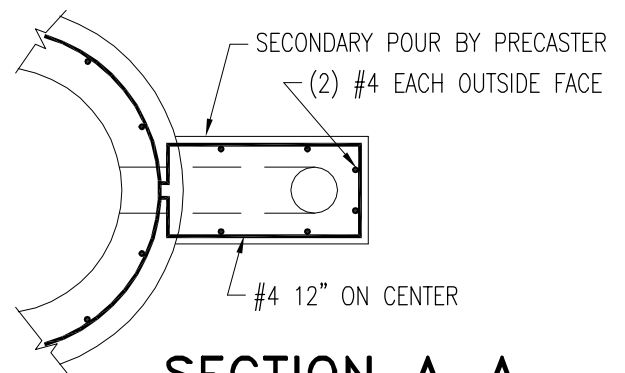

SECTION A-A

STANDARD MANHOLE	SS 6.0	
FLOW PATTERNS	SS 10.0	
MANHOLE COVER	SS 4.0	
ITEM	CROSS REF.	SPEC. REF.